



Testing Lab.

Shenzhen LCS Compliance Testing Laboratory Ltd.



TESTING
NVLAP LAB CODE 600112-0

Report No.: LCS1701141730S

TEST REPORT of IES LM-79-08

Approved Method for Electrical and Photometric Measurements of Solid-State Lighting Products

Client..... : Shenzhen Hipower Optronics Co.,Ltd

Address..... : A Bldg, Ying HaoSheng Industrial Park, Da Yang Development Zone, Fu Yong
Town,Baoan District, Shenzhen City Guangdong Province 518103 China

Brand Name..... : LED VISION

Testing laboratory..... : Shenzhen LCS Compliance Testing Laboratory Ltd.

Address..... : B Area, 2F, Building B, Zhongyu Green High-tech Industrial Park, Wenge Road,
Heshuikou, Gongming Street, Guangming New District, Shenzhen, Guangdong,
China

Product description .. : Fuel Pump Canopy Luminaires

Models..... : SPS35-CL1-CW

Rating..... : 35W AC100-277V 50/60HZ 0.45A Max

Test by: Ian Luo

Signature: Ian Luo

Reviewed by: Jesse Liu

Signature:



Test date: May 25, 2017

Reviewed date: June 01, 2017

The duplication of this report or parts of it and its use for advertising purposes is only allowed with permission of the testing laboratory. This report contains the result of examination of the product sample submitted by the appliance. A general statement concerning the quality of the products from the series manufacture cannot be derived therefore. This report can be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST, or any agency of the Federal Government.

Table of Contents

1. Test Method.....	3
2.Product Information.....	3
3.Test equipment list:.....	3
4. Integrating Sphere Test Results :	4
4.1 Test Data.....	4
4.2 Spectrum.....	4
5. Photo of sample:.....	5



1. Test Method

Report No.: LCS1701141730S

Test Item.....: Integrating Sphere Test
Ambient Condition: 25.1°C
Stabilization time(h): 0.5h
Orientation(burning position) of SSL product during test: down
Test Method: The sample was tested according to the IES LM-79-2008.
The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

2.Product Information

Product description.....: LED Canopy Light
Model Number.....: SPS35-CL1-CW
Rated Inputs.....: AC100-277V 50/60HZ
Rated Power.....: 35W
Declared CCT.....: 5700K
LED Manufacturer.....: Philips
LED Model.....: LUXEON 3030 2D
Forward current of the LED chip.....: 150 mA
Date of Receipt Samples.....: April 10, 2017
Quantity of Receipt Samples.....: 1 unit

3.Test equipment list:

Table with 6 columns: Manufacturer, Description, Equipment ID, Model, Calibration Date, Calibration Due Date. Rows include SENSING Integrating Sphere System, YOKOGAWA Digital Power Meter, ALL POWER ELECTRONIC AC Testing Power Source, and SENSING Standard Lamp.

4. Integrating Sphere Test Results :

Report No.: LCS1701141706S



4.1 Test Data

Test type	Voltage (V AC)	Frequency (Hz)	Current (A)	Power Factor	Power (w)
Input	119.9	60.0	0.301	0.995	35.9

Test type	CCT (K)	CRI	Luminous flux (lm)	Luminous efficacy(lm/w)
Output	5992	75.1	4182.35	116.5

4.2 Spectrum

Spectroradiometric Parameters

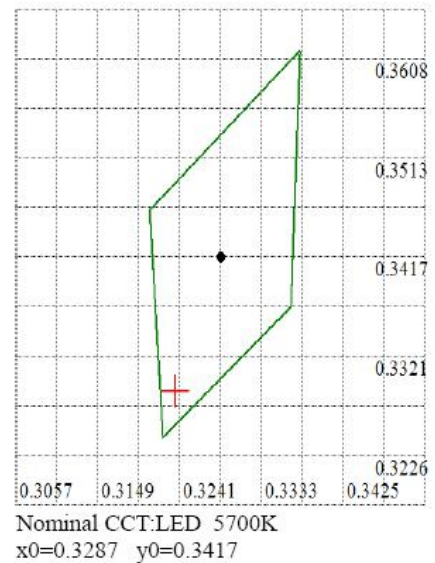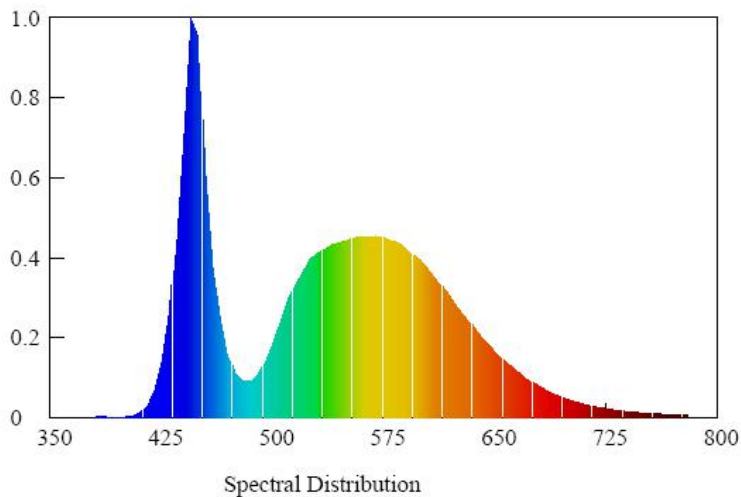

Chromaticity Coordinates: x=0.3235 y=0.3288 u'=0.2063 v'=0.4668

Correlated Color Temperature: 5992 K

Dominant Wavelength: 479.0 nm(E)

Colour Fidelity Index: Rf=69

Gamut Index: Rg=97

Luminous Flux: 4182.35 lm

Purity: 0.0473

Chromaticity Difference: -0.004Duv

Peak Wavelength: 445.0 nm

Color Ratio: Kr=31.5% Kg=58.8% Kb=9.6%

Bandwidth: 21.7nm

Radiant Flux: 12.685 W

Photosynthetically Active Radiation(PAR): 12.48W

Photosynthetic Photon Flux(PPF):56.48μmol/s

Rendering Index: Ra=75.1

R1=76 R2=78 R3=77 R4=78 R5=77 R6=69 R7=80 R8=67

R9=-6 R10=45 R11=78 R12=47 R13=75 R14=86 R15=73 Re=67



Testing Lab.


Shenzhen LCS Compliance Testing Laboratory Ltd.



TESTING
NVLAP LAB CODE 600112-0

5. Photo of sample:

Report No.: LCS1701141730S

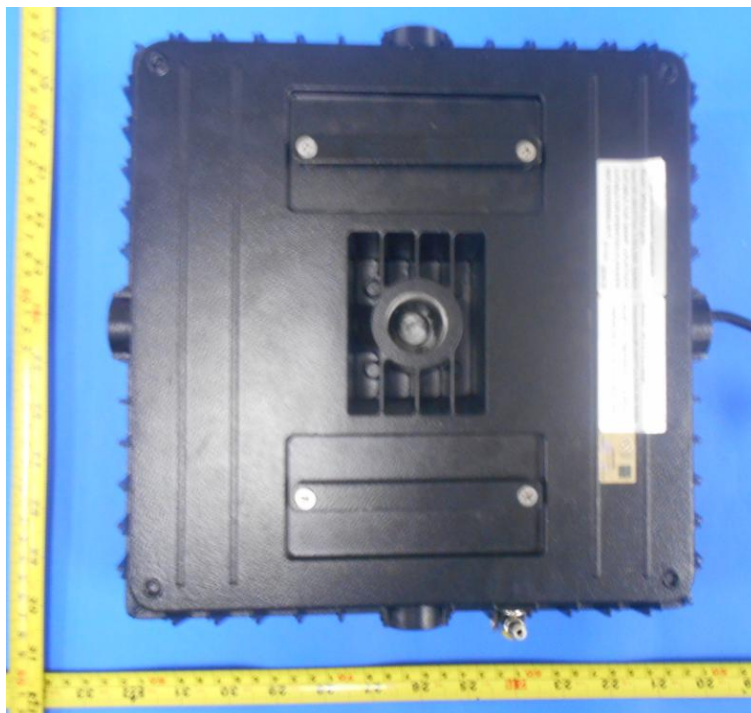

----- End of test report-----